


NOTE:

- Meter Base to be Spotted by Nolin RECC Personnel
- Individual Meters in Gang Meter Base rated 100A or above shall have By-Pass Levers

UNDERGROUND SERVICE FOR MULTI-FAMILY DWELLING

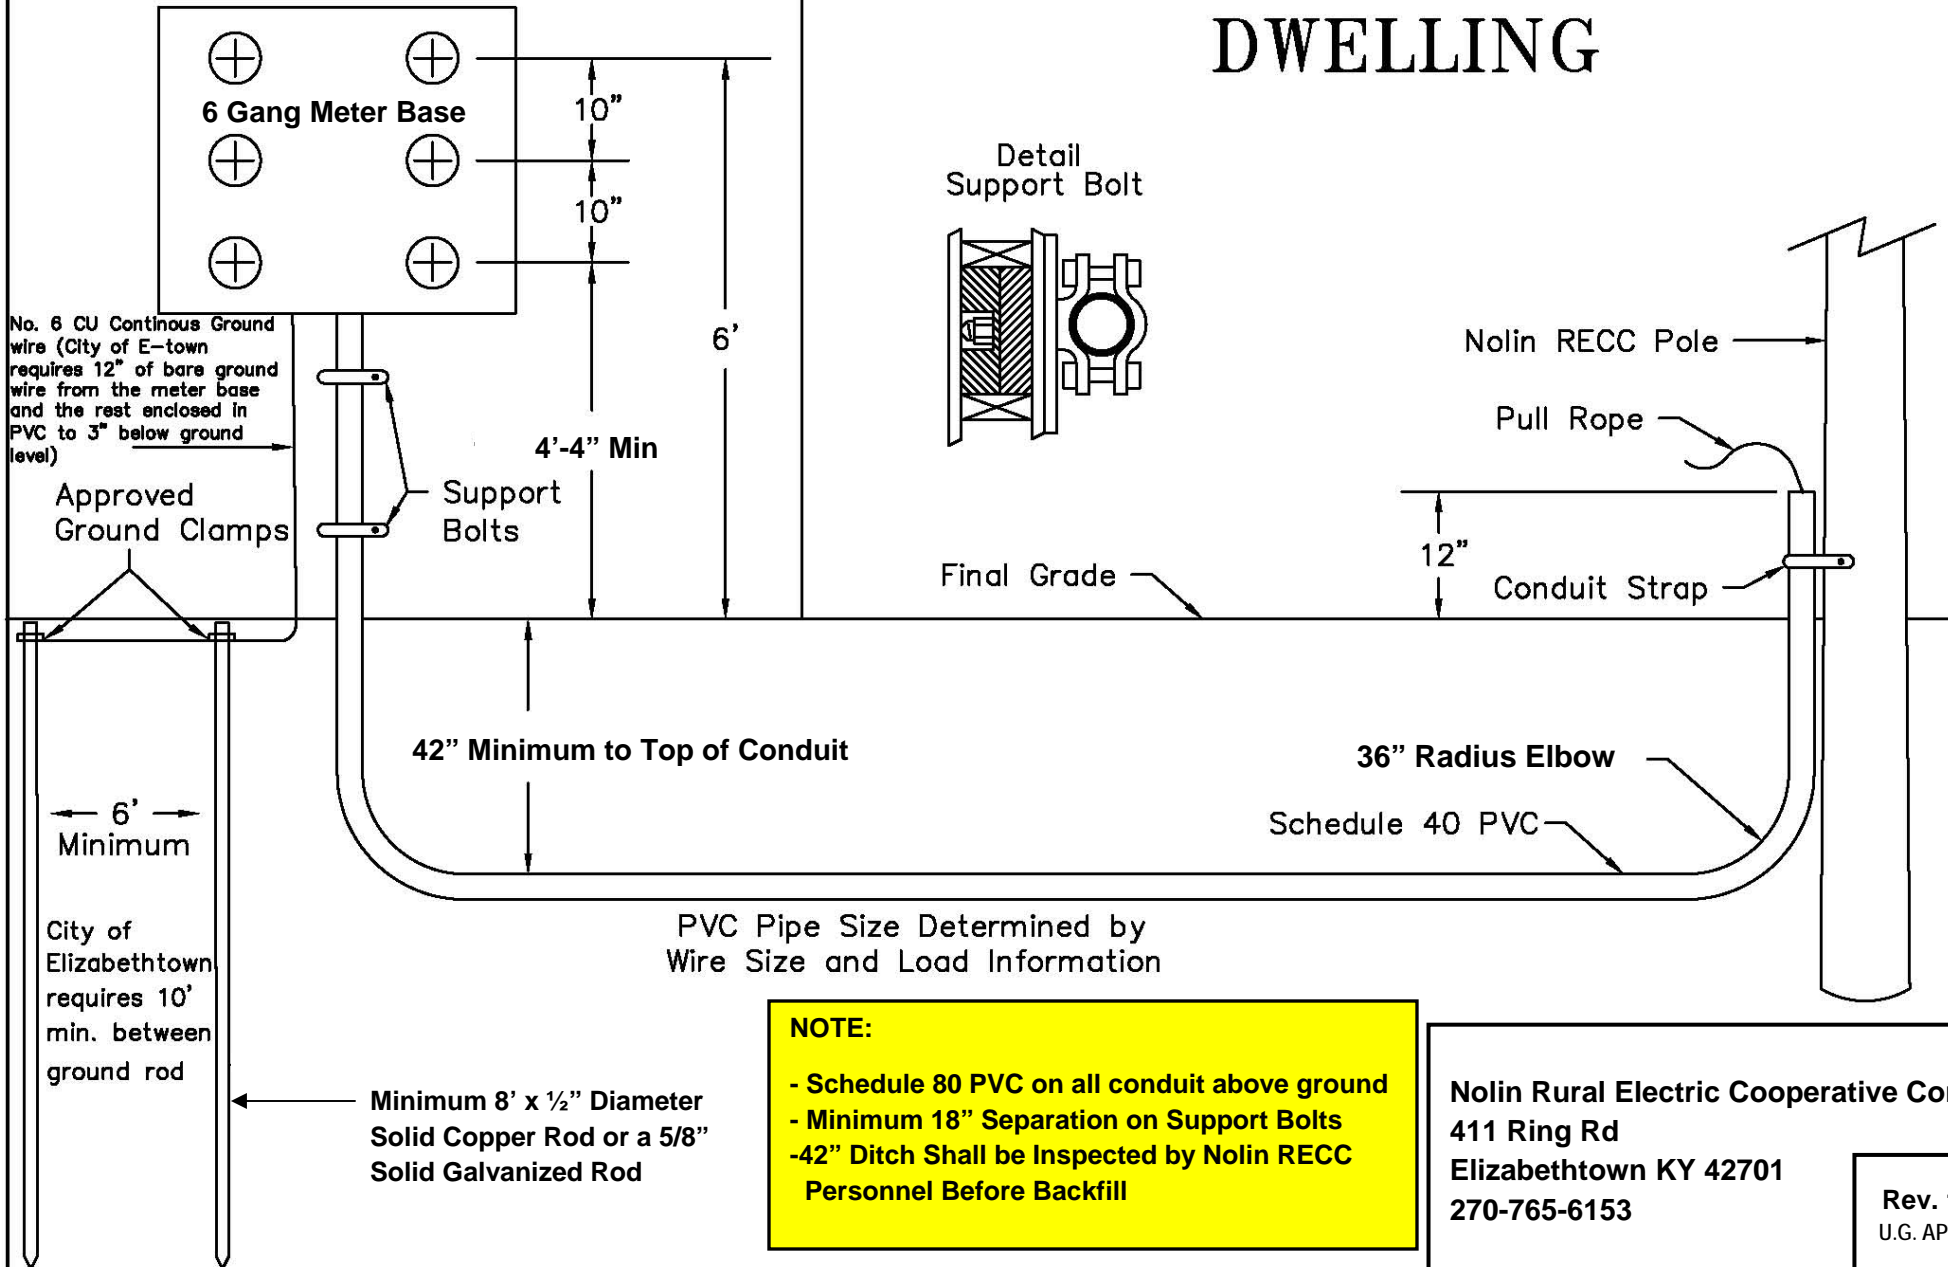

NOTE:

- Schedule 80 PVC on all conduit above ground
- Minimum 18" Separation on Support Bolts
- 42" Ditch Shall be Inspected by Nolin RECC Personnel Before Backfill

Nolin Rural Electric Cooperative Corp.
411 Ring Rd
Elizabethtown KY 42701
270-765-6153

Rev. 11/07
U.G. APT-POLE