NOTE:

- **Meter Base to be Spotted by Nolin RECC Personnel**
- **Individual Meters in Gang Meter Base rated 100A or above shall have By-Pass Levers**

UNDERGROUND SERVICE FOR MULTI-FAMILY DWELLING

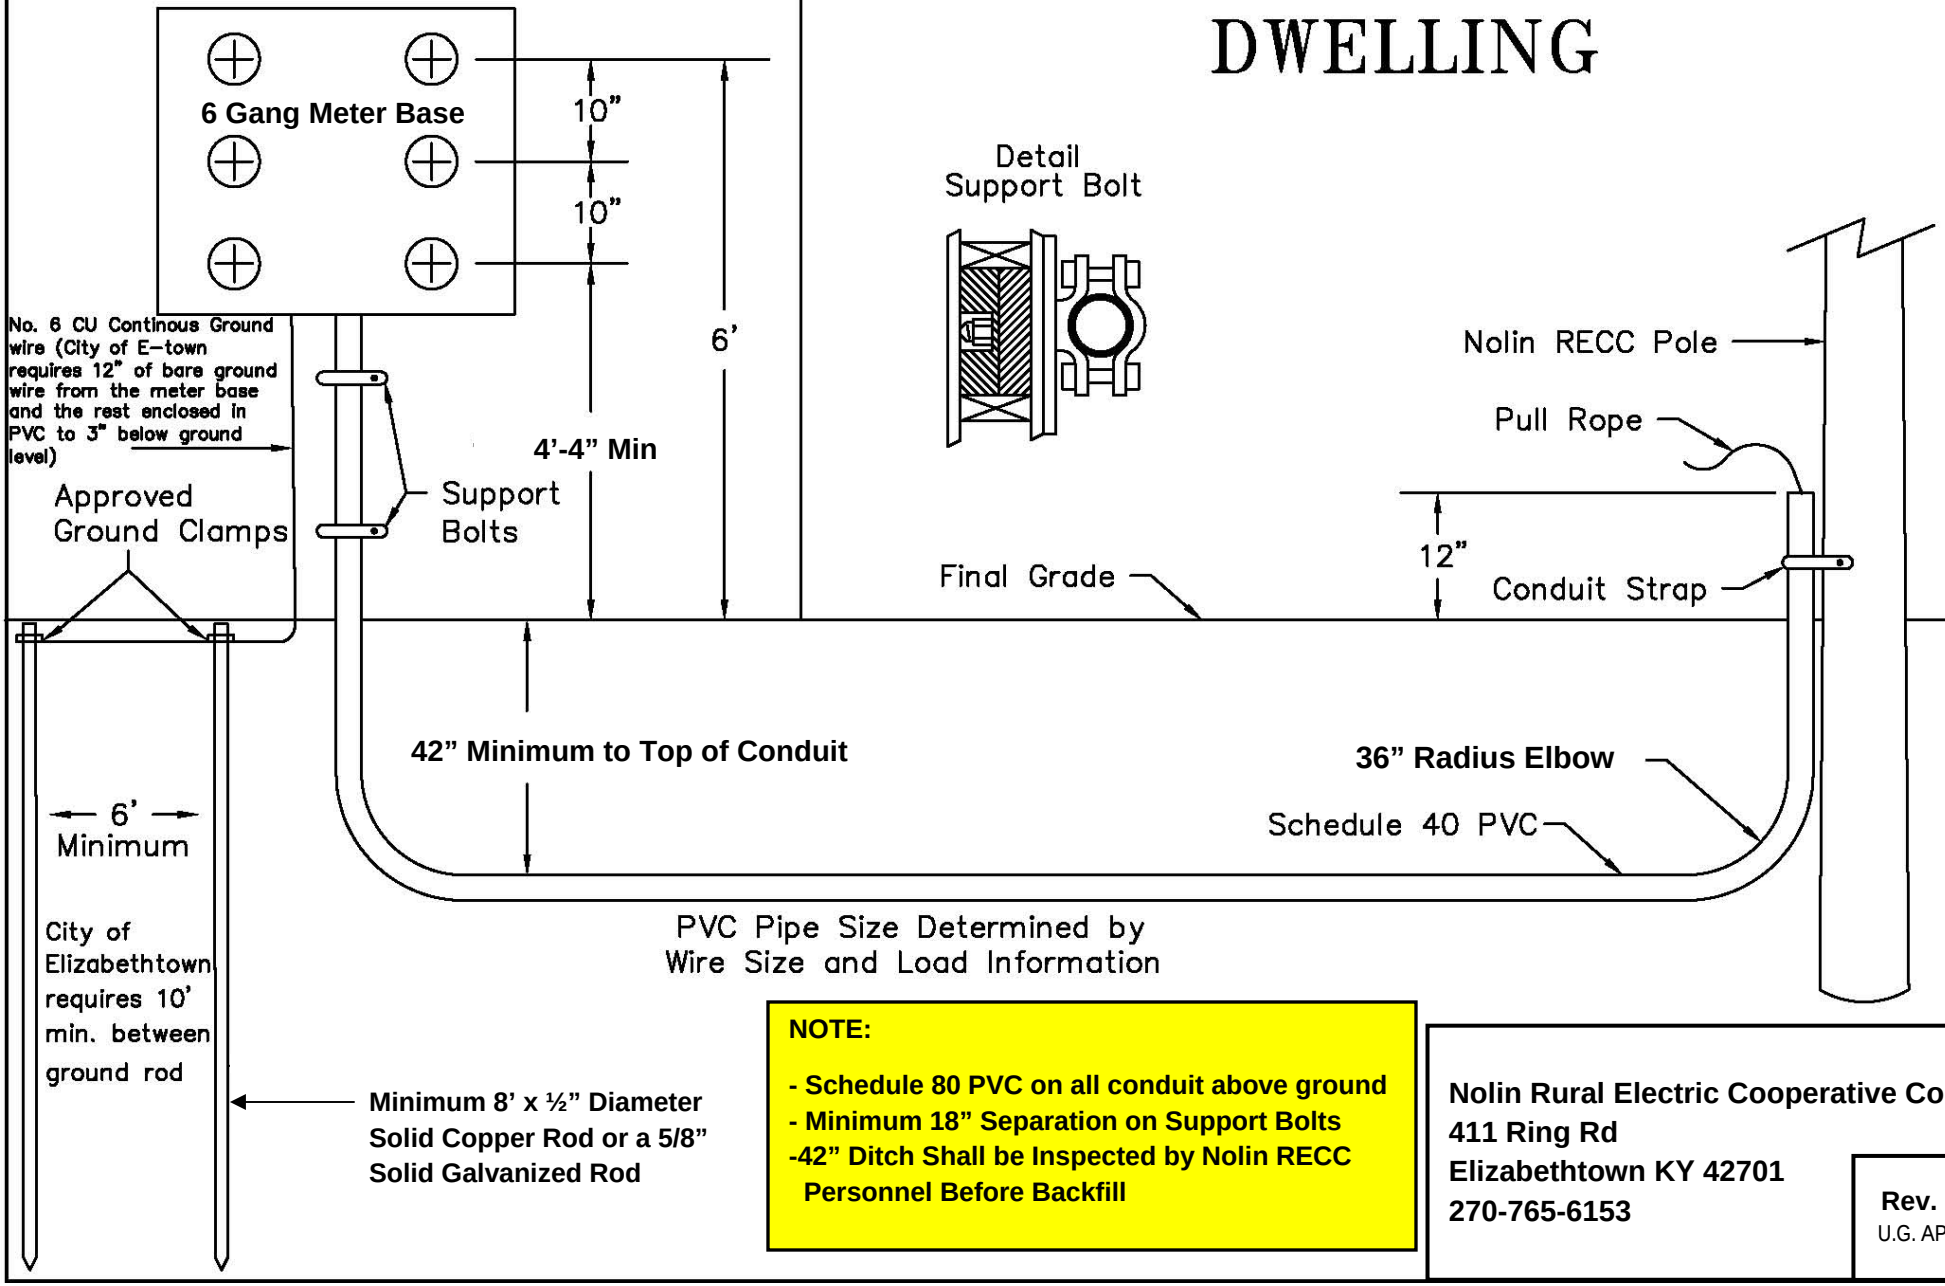

NOTE:

- **Schedule 80 PVC on all conduit above ground**
- **Minimum 18" Separation on Support Bolts**
- **42" Ditch Shall be Inspected by Nolin RECC Personnel Before Backfill**

Nolin Rural Electric Cooperative Corp.
411 Ring Rd
Elizabethtown KY 42701
270-765-6153

Rev. 11/07
U.G. APT-POLE