



NOTE:

- Meter Base to be Spotted by Nolin RECC Personnel

UNDERGROUND SERVICE ENTRANCE

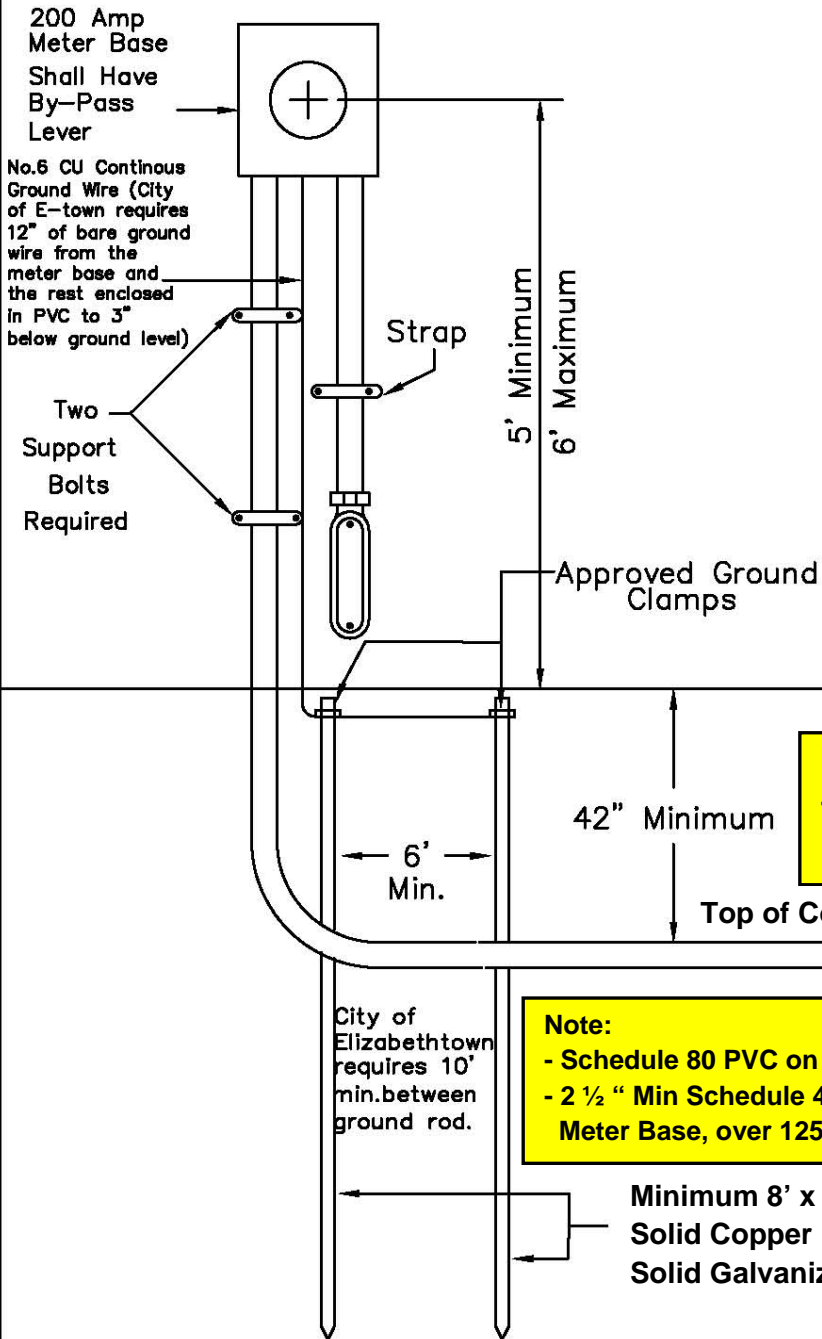

Detail Support Bolt



Final Grade

Nolin RECC Pole

Pull Rope

12"

Conduit Strap

36" Radius Elbow

NOTE:

- 42" Ditch Shall be Inspected by Nolin RECC Personnel Before backfill

Note:

- Schedule 80 PVC on all conduit above ground
- 2 1/2" Min Schedule 40 PVC if under 125' from Nolin Pole to Meter Base, over 125' use 3" Min Schedule 40 PVC

Minimum 8' x 1/2" Diameter Solid Copper Rod or a 5/8" Solid Galvanized Rod

Nolin Rural Electric Cooperative Corp.
411 Ring Rd
Elizabethtown KY 42701
270-765-6153

Rev. 11/07
URD