


# UNDERGROUND TEMPORARY SERVICE

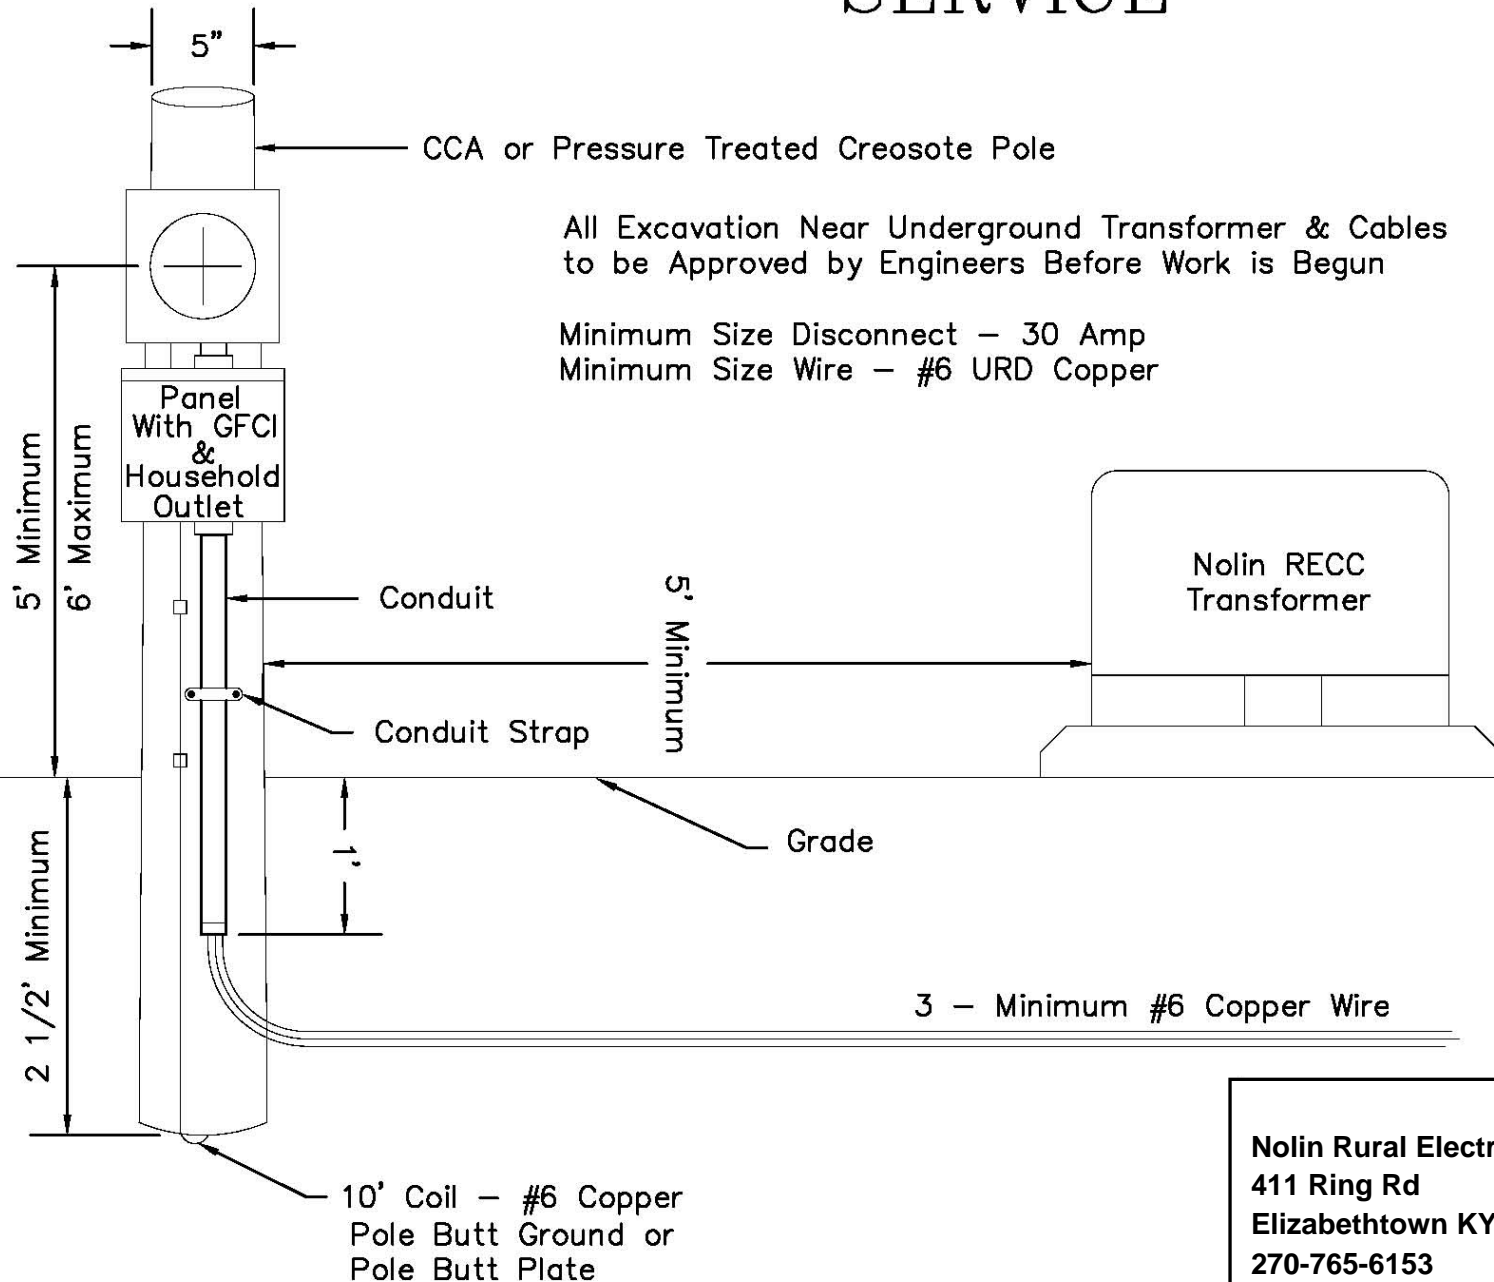

All Excavation Near Underground Transformer & Cables to be Approved by Engineers Before Work is Begun

Minimum Size Disconnect - 30 Amp  
Minimum Size Wire - #6 URD Copper

Nolin Rural Electric Cooperative Corp.  
411 Ring Rd  
Elizabethtown KY 42701  
270-765-6153

Rev. 11/07  
URD TMP